

Zeitschrift: IABSE congress report = Rapport du congrès AIPC = IVBH
Kongressbericht

Band: 12 (1984)

Artikel: Design method for solar control

Autor: Sagelsdorff, Ralph / Frank, Thomas / Püntener, Toni W.

DOI: <https://doi.org/10.5169/seals-12173>

Nutzungsbedingungen

Die ETH-Bibliothek ist die Anbieterin der digitalisierten Zeitschriften auf E-Periodica. Sie besitzt keine Urheberrechte an den Zeitschriften und ist nicht verantwortlich für deren Inhalte. Die Rechte liegen in der Regel bei den Herausgebern beziehungsweise den externen Rechteinhabern. Das Veröffentlichen von Bildern in Print- und Online-Publikationen sowie auf Social Media-Kanälen oder Webseiten ist nur mit vorheriger Genehmigung der Rechteinhaber erlaubt. [Mehr erfahren](#)

Conditions d'utilisation

L'ETH Library est le fournisseur des revues numérisées. Elle ne détient aucun droit d'auteur sur les revues et n'est pas responsable de leur contenu. En règle générale, les droits sont détenus par les éditeurs ou les détenteurs de droits externes. La reproduction d'images dans des publications imprimées ou en ligne ainsi que sur des canaux de médias sociaux ou des sites web n'est autorisée qu'avec l'accord préalable des détenteurs des droits. [En savoir plus](#)

Terms of use

The ETH Library is the provider of the digitised journals. It does not own any copyrights to the journals and is not responsible for their content. The rights usually lie with the publishers or the external rights holders. Publishing images in print and online publications, as well as on social media channels or websites, is only permitted with the prior consent of the rights holders. [Find out more](#)

Download PDF: 22.02.2026


ETH-Bibliothek Zürich, E-Periodica, <https://www.e-periodica.ch>

Design Method for Solar Control

Méthode d'évaluation de la protection solaire


Methode zur Beurteilung von Sonnenschutz-Massnahmen

Ralph SAGELSDORFF
Civil Engineer
EMPA
Dübendorf, Switzerland

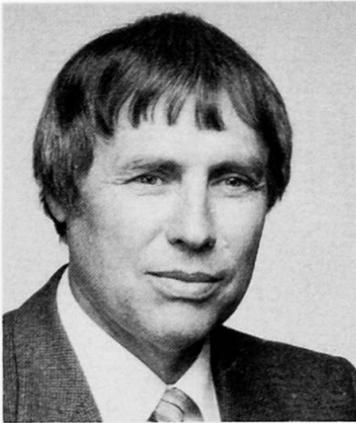

Ralph Sagelsdorff, born 1929, got his civil engineering degree at the Swiss Federal Institute of Technology in Zürich. After 4 years of design work in the United States and Switzerland he entered the Swiss Laboratories for Materials Testing and Research (EMPA). He became 1968 section head of the section building physics.

Thomas FRANK
Civil Engineer
EMPA
Dübendorf, Switzerland

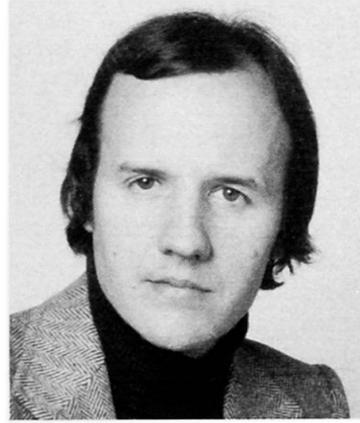

Th. Frank, born 1950, got his civil engineering degree 1975 at the Swiss Federal Inst. of Technology (ETH) in Zürich. Since 1978 he is working on research projects at the Swiss Federal Laboratories for Materials Testing and Research (EMPA) dealing with measurements and calculation methods on energy consumption of buildings.

Toni W. PÜNTENER
HVAC Engineer
EMPA
Dübendorf, Switzerland



Toni W. Püntener, born 1959, got 1983 his bachelor of science at the college of Engineering (Department of HVAC Engineering) in Lucerne. Since then he is working at the Swiss Federal Laboratories for Materials Testing and Research (EMPA) on calculation models for energy consumption in buildings.

SUMMARY

Solar control for residential and commercial buildings is important to maintain thermal comfort and reduce energy consumption. The comfort criteria for summer conditions must be considered carefully, especially in passive solar buildings with high solar gains. A nomogram for the rapid determination of the critical maximum indoor air temperature is given, based on a parametric analysis, considering solar transmission factor, shading devices, window area, internal heat source and building mass.

RESUME

La protection solaire dans les bâtiments résidentiels et commerciaux est importante pour le maintien du confort thermique et la réduction de la consommation d'énergie. Le critère de confort pour les conditions en été doit être considéré soigneusement, spécialement pour certains bâtiments à énergie solaire passive. Une abaque pour la détermination rapide de la température de l'air intérieur maximal critique, basée sur une analyse paramétrique considérant le facteur de transmission solaire, les dispositifs d'ombrage, la surface des fenêtres, la source intérieure de chaleur et la masse du bâtiment, est donnée.

ZUSAMMENFASSUNG

Das Festlegen von Sonnenschutzmassnahmen bei Wohn- und Geschäftsbauten ist wichtig zur Aufrechterhaltung der Behaglichkeit und für Energieeinsparungen. Besonders bei Bauten mit einer hohen passiven Sonnenenergienutzung sind die sommerlichen Behaglichkeitskriterien sorgfältig zu überprüfen. Es wird ein Nomogramm vorgestellt für die rasche Bestimmung der kritischen maximalen Raumlufttemperatur. Das Nomogramm basiert auf einer Parameterstudie und berücksichtigt Gesamtenergiedurchlassgrad, Beschattungseinrichtungen, Fensterfläche, innere Wärmequellen und Gebäudespeichermasse.



1. INTRODUCTION

Typical of central Europe, the climate of Switzerland calls for many days of heating in winter. Excluding buildings with high internal heat sources, no cooling is normally required in summer.

However, the summer season can present problems since a period of sunny summer days can produce excessive indoor temperatures which severely reduce the thermal comfort and working capacity of the occupants.

Architects and engineers must therefore design the building for effective solar control to avoid overheating. This is especially true for buildings designed for high solar gains in winter to reduce heating loads. Good solar control for summer conditions may also preclude the need for air conditioning and reduce the total energy consumption.

The architect would benefit from a simple tool to check his designs concerning solar protection, to compare different alternatives and to be alerted to critical situations in which more sophisticated calculations by specialists are necessary.

The maximum indoor temperature during a typical period of sunny summer days is chosen as criterion for the thermal response of the building. The critical maximum indoor temperature depends on the following parameters:

- solar gains (influenced by window size, solar transmittance of the glass and the shading devices),
- internal heat sources (lighting, office machines and installations, occupants),
- thermal storage capacity of the internal building mass,
- air infiltration rate.

2. ASSUMPTIONS AND METHOD

The proposed method employs a nomogram for the rapid determination of the critical maximum indoor temperature $t_{i,max}$ in a chosen room. It is usually possible to select one or a few critical rooms in a building, check these with the nomogram and then apply this solar control to the entire building.

The nomogram gives estimated values and is subject to the following limitations:

- room geometry: ratio of room width-to-depth 1/2 to 2
- window area: orientation from east, south to west
(the nomogram is not valid for roof windows)
- thermal insulation:

U-value, roof	<	0.4 W/m ² K
walls	<	0.6 W/m ² K
windows		1.4 to 3.0 W/m ² K
- no heat absorbing window glass
- air infiltration rate: 0.5 per h, daily mean value
- internal heat sources: 0 to 50 W/m² floor area

Thus, the method applies to residential and commercial buildings, offices up to moderate size.

The nomogram is based on a parametric analysis with a computer program considering the varying ambient air temperature, solar radiation and the dynamic behavior of the building.

3. EXTERNAL CLIMATE

A typical period of 5 summer days was selected from the available data [1].

Fig. 1 and 2 give the fluctuations of ambient air temperature and solar radiation.

These diagrams can be considered valid for Swiss climatic conditions up to an elevation of about 800 m above sea level. This covers most of the populated area. The maximum ambient air temperature is 33°C and the daily amplitude, 14 to 16 K.



Higher altitudes can also be checked by reading the overheating ($\Delta\theta$) from the nomogram. This overheating is defined as the temperature difference between maximum indoor air temperature ($t_{i,max}$) and maximum ambient air temperature ($t_{a,max}$) occurring during the 5 day period. The maximum ambient air temperature, decreasing with increasing altitude, can be taken from Fig. 6. Extrapolation to altitudes up to about 1600 m is acceptable because the measured data show that solar radiation in summer does not vary greatly with altitude.

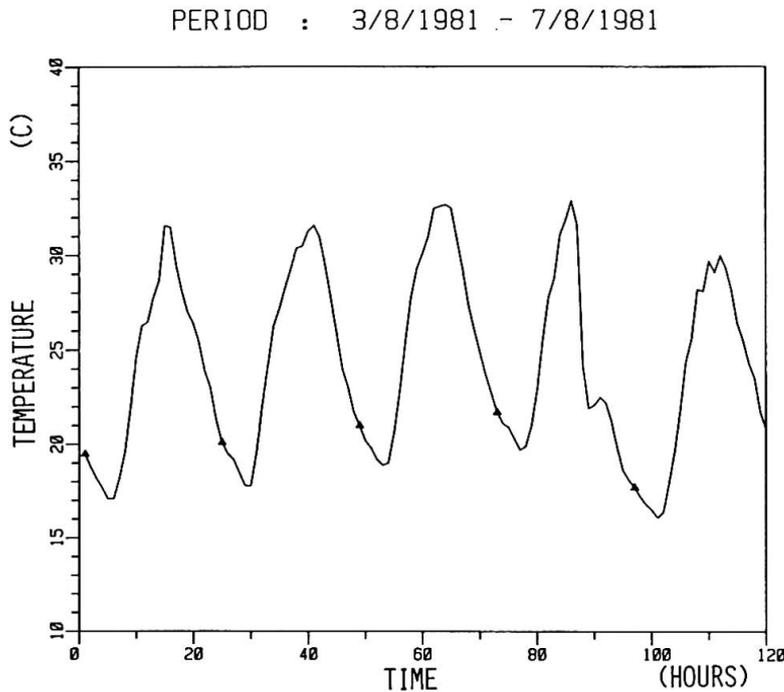


Fig. 1: Typical summer ambient air temperature for Swiss climatic conditions (Geneva 420 m).

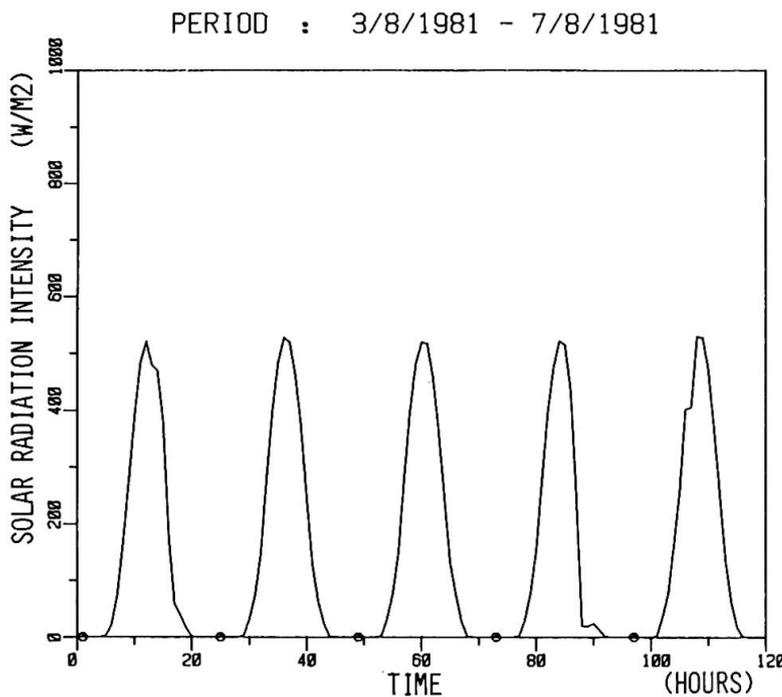


Fig. 2: Global solar radiation intensity on south facade for summer conditions.



4. SIMULATION MODEL

The parametric analysis was performed with the computer program HELIOS 1 [2, 4]. This program calculates the thermal behavior of the building and indoor air temperature in hourly intervals on the basis of weather data, i.e. ambient air temperature, wind velocity, solar and atmospheric long-wave radiation. The building interior is considered as one zone, here one selected room. The calculation of the heat transfer through the walls and the window area uses the ASHRAE procedure [3].

This program has been verified and evaluated by measurements and gives an estimated accuracy of about 1 K in air temperatures and 10 % in daily heating loads (non-existent in summer). Fig. 3 gives a typical result of the evaluation.

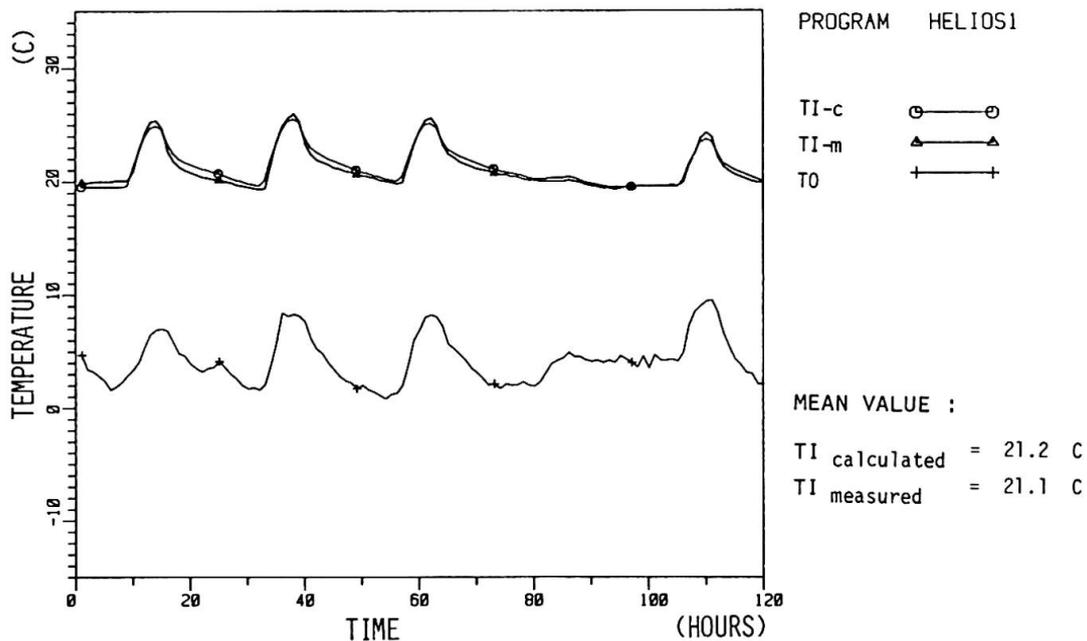


Fig. 3: Comparison of measured and calculated indoor air temperature for a south oriented room.

TI-c: Indoor temperature, calculated
 TI-m: Indoor temperature, measured
 TO: Ambient air temperature

In Fig. 4 and 5, results from the parametric analysis are given. They show the influence of window area on the indoor air temperature for heavy and light building constructions.

5. NOMOGRAM AS DESIGN TOOL

Fig. 7 and 8 give two examples for the use of the nomogram. One enters the following parameters in sequence:

- solar transmission factor of the window area. This factor includes the standard transmission properties of the glass, the reduction of transmission area by window frames and the shading effect of building parts, shutters or Venetian blinds. The total solar transmission factor must be determined (calculated or estimated) by the designer.
- ratio of window area divided by floor area ($A_{\text{window}}/A_{\text{floor}}$). Windows in two different facades are treated additively (Fig. 8).
- internal heat source. The mean daily value per m^2 floor area is used.

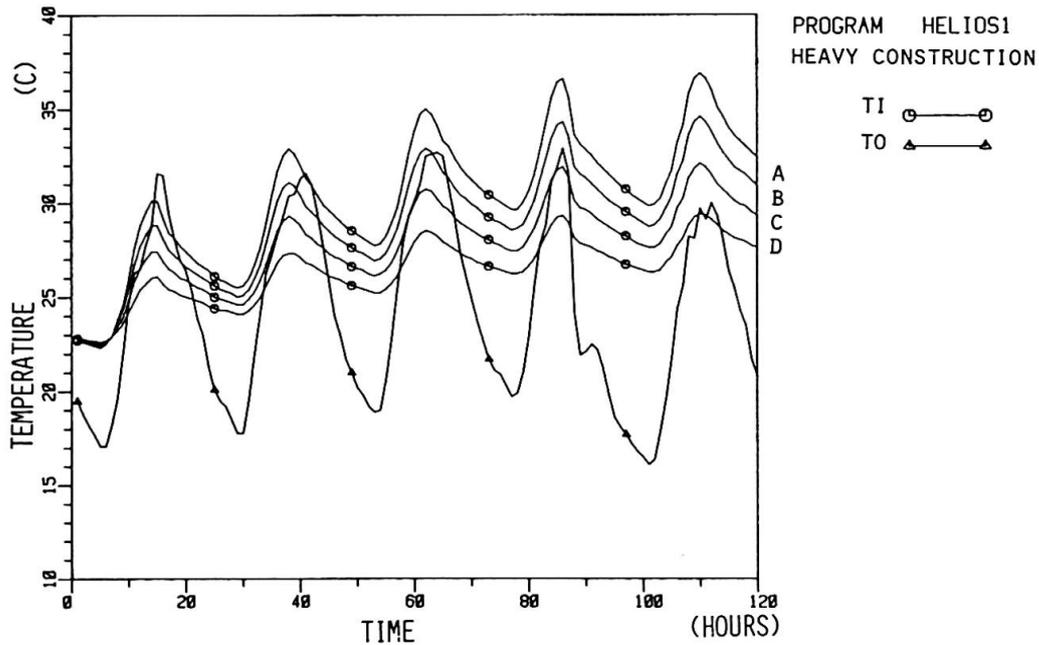


Fig. 4: Calculated indoor air temperatures of a heavy building construction for different ratios of window to floor area A_w/A_f : A=50%, B=40%, C=30%, D=20%.

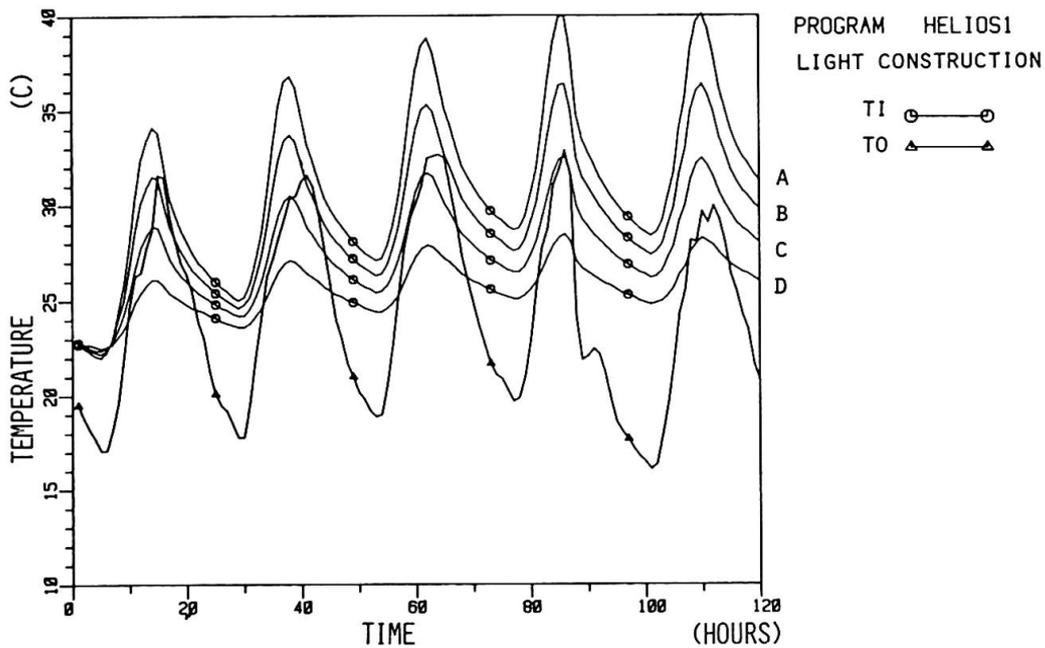


Fig. 5: Calculated indoor air temperatures of a light building construction for different ratios of window to floor area A_w/A_f : A=40%, B=30%, C=20%, D=10%.

- building mass. Three categories are defined:

- I Heavy construction with floor and ceiling of reinforced concrete without thermal or acoustical insulation on the inner surface, textile floor covering not thicker than 10 mm, walls of brick, concrete, porous concrete blocks, etc.
- II medium construction with floor and ceiling as above. A suspended lightweight ceiling and light interior walls are possible.



III light construction using lightweight panels, wood construction, etc. or heavy construction in which the building mass is covered with thermal or accoustical insulation.

If the room is furnished very densely, it must be classified in a lighter category due to the shielding effect.

For these entries the nomogram gives the predicted maximum indoor air temperature $\vartheta_{i,max}$ (Example Fig. 7) or the overheating $\Delta\vartheta$ (Example Fig. 8).

If this temperature is too high, the designer can either decrease the solar transmittance (more shading, other glass properties) or decrease the window area.

For Swiss climatic conditions, a maximum indoor air temperature of about 30°C is generally considered as acceptable.

The orientation of the facade is not taken into account in this method because the calculations show only small differences in the maximum indoor air temperature for summer conditions. They occur of course at different hours of the day.

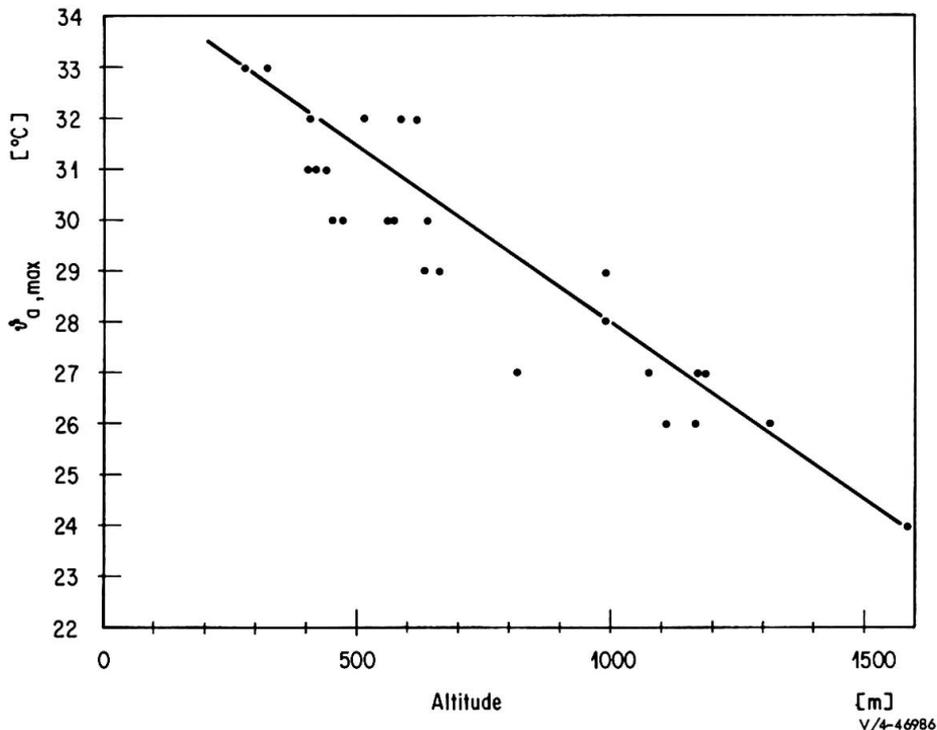


Fig. 6: Correlation between highest summer ambient air temperature and altitude for Swiss climatic conditions.

REFERENCES

- 1 FRANK, TH., Summary of Meteorological Data of Geneva 1980/81. EMPA Report, August 1983
- 2 FRANK, TH., Program Manual HELIOS 1. EMPA Report, October 1982
- 3 ASHRAE, Procedure for Determining Heating and Cooling Loads for Computerizing Energy Calculations, Algorithms for Building Heat Transfer Subroutines, New York 1976
- 4 SAGELSDORFF, R., et. al., Influence of Radiation Processes at the Building Envelope on the Energy Consumption. IABSE Congress Vienna, 1980

Nomogram for Solar Control

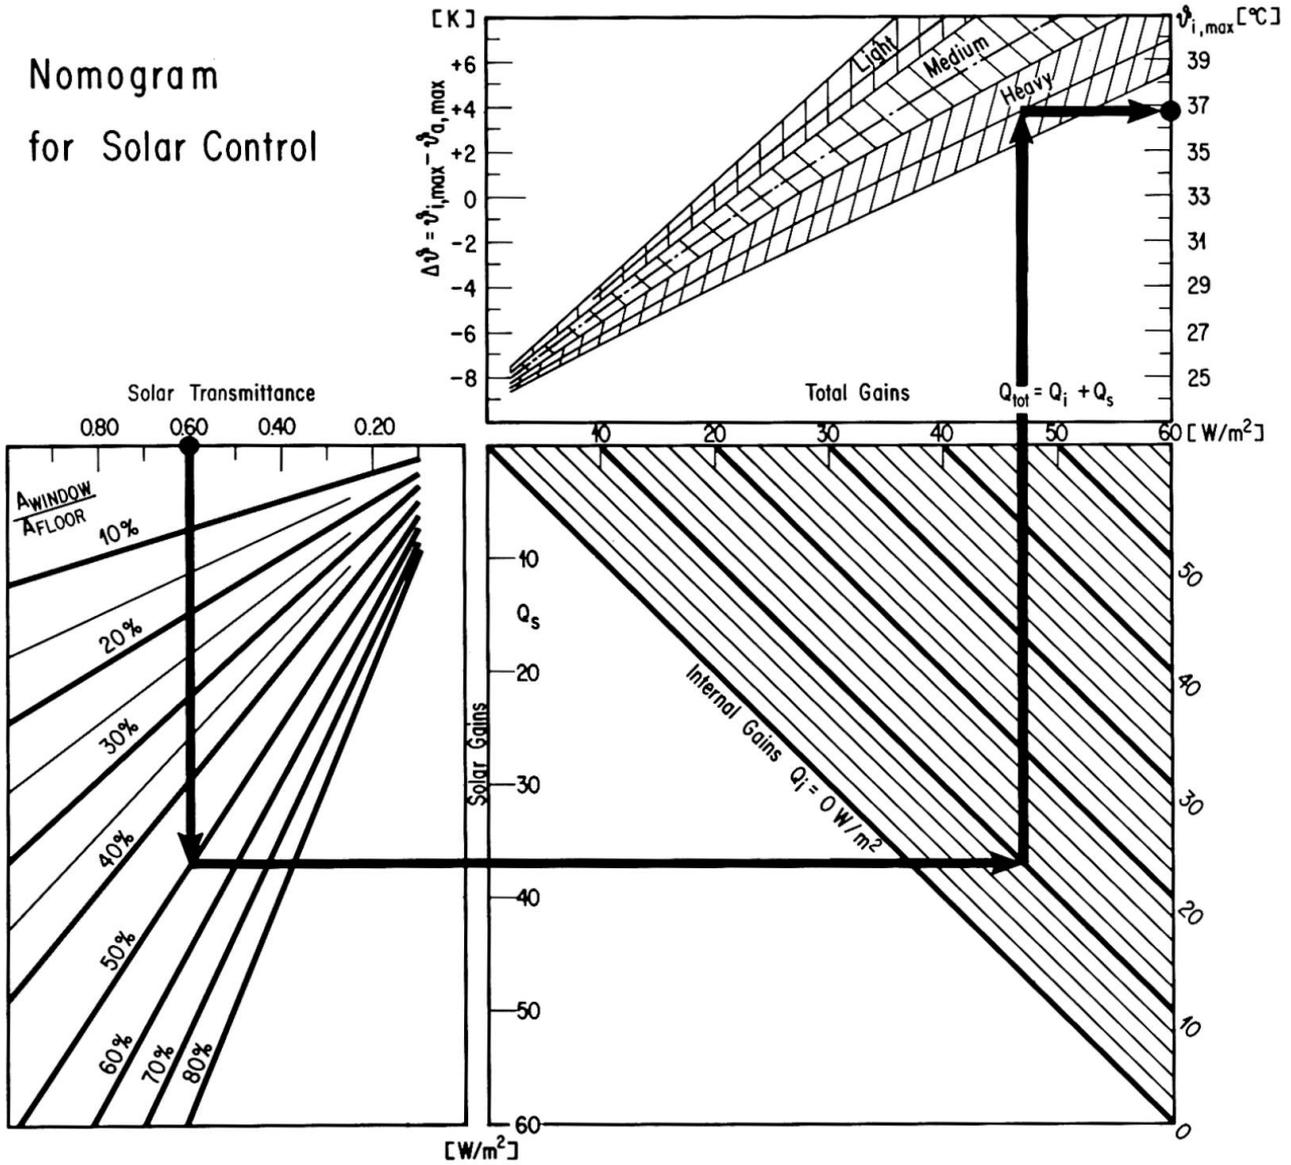


Fig. 7: Nomogram for solar control (Swiss climatic conditions)

Example A: Mid-zone room heavy construction

Location Zurich

Solar transmittance

Window area (south)

Floor area

Ratio window to floor area

Internal heat sources

Result:

Maximum indoor air temperature

$$t_{a,max} = 33 \quad ^\circ\text{C}$$

$$g = 0.60$$

$$A_w = 20 \quad \text{m}^2$$

$$A_f = 40 \quad \text{m}^2$$

$$A_w/A_f = 50 \quad \%$$

$$Q_i = 10 \quad \text{W/m}^2$$

$$t_{i,max} = 37 \quad ^\circ\text{C}$$

additional shading required

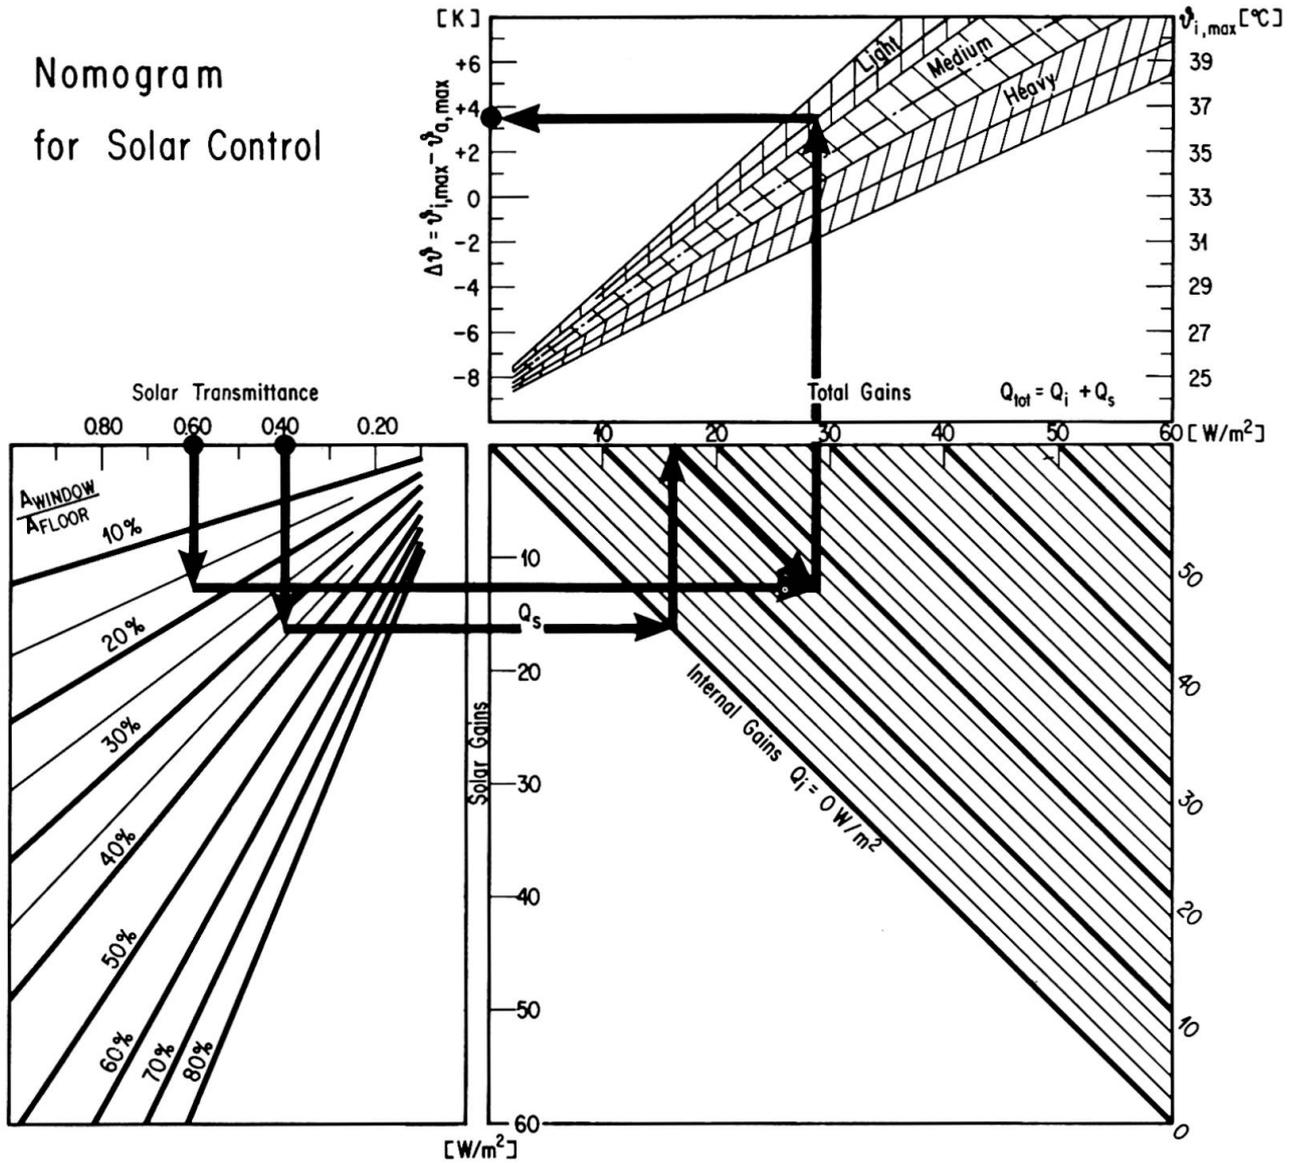


Fig. 8: Nomogram for solar control (Swiss climatic conditions)

Example B: Corner room, lightweight construction

Location 1300 m above sea level

Maximum ambient air temperature (see Fig.7)

Solar transmittance of south windows

South window area

Floor area

Ratio window to floor area (south)

No internal heat gains

Solar transmittance of west windows

West window area

Ratio window to floor area (west)

Procedure:

Step 1 - Determine solar gain from south windows

Step 2 - Determine solar gain from west windows

addition to determine total gain

Result:

Overheating

Maximum indoor air temperature $t_{i,max} = 26+3$

$$t_{a,max} = 26 \text{ } ^\circ\text{C}$$

$$g_s = 40 \text{ } \%$$

$$A_w = 10 \text{ } \text{m}^2$$

$$A_f = 30 \text{ } \text{m}^2$$

$$A_w/A_f = 33 \text{ } \%$$

$$Q_i = 0 \text{ } \text{W}/\text{m}^2$$

$$g_w = 60 \text{ } \%$$

$$A_w^w = 5 \text{ } \text{m}^2$$

$$A_w^w/A_f = 17 \text{ } \%$$

$$Q_s(s) \approx 16 \text{ } \text{W}/\text{m}^2$$

$$Q_s(w) \approx 12 \text{ } \text{W}/\text{m}^2$$

$$Q_{tot} \approx 28 \text{ } \text{W}/\text{m}^2$$

$$\Delta t \approx +3 \text{ } \text{K}$$

$$\approx 29 \text{ } ^\circ\text{C}$$

acceptable