

Zeitschrift: IABSE congress report = Rapport du congrès AIPC = IVBH
Kongressbericht

Band: 13 (1988)

Artikel: Development of reticulated steel cooling towers

Autor: Kollár, Lajos / Cholnoky, Péter

DOI: <https://doi.org/10.5169/seals-13156>

Nutzungsbedingungen

Die ETH-Bibliothek ist die Anbieterin der digitalisierten Zeitschriften auf E-Periodica. Sie besitzt keine Urheberrechte an den Zeitschriften und ist nicht verantwortlich für deren Inhalte. Die Rechte liegen in der Regel bei den Herausgebern beziehungsweise den externen Rechteinhabern. Das Veröffentlichen von Bildern in Print- und Online-Publikationen sowie auf Social Media-Kanälen oder Webseiten ist nur mit vorheriger Genehmigung der Rechteinhaber erlaubt. [Mehr erfahren](#)

Conditions d'utilisation

L'ETH Library est le fournisseur des revues numérisées. Elle ne détient aucun droit d'auteur sur les revues et n'est pas responsable de leur contenu. En règle générale, les droits sont détenus par les éditeurs ou les détenteurs de droits externes. La reproduction d'images dans des publications imprimées ou en ligne ainsi que sur des canaux de médias sociaux ou des sites web n'est autorisée qu'avec l'accord préalable des détenteurs des droits. [En savoir plus](#)

Terms of use

The ETH Library is the provider of the digitised journals. It does not own any copyrights to the journals and is not responsible for their content. The rights usually lie with the publishers or the external rights holders. Publishing images in print and online publications, as well as on social media channels or websites, is only permitted with the prior consent of the rights holders. [Find out more](#)

Download PDF: 09.08.2025

ETH-Bibliothek Zürich, E-Periodica, <https://www.e-periodica.ch>



Development of Reticulated Steel Cooling Towers

Développement des tours de refroidissement en treillis d'acier

Entwicklung von Stahlfachwerk-Kühltürmen

Lajos KOLLÁR

Dr. techn.

IPARTERV

Budapest, Hungary

Péter CHOLNOKY

Civ. Eng.

IPARTERV

Budapest, Hungary

Although most cooling towers are made of reinforced concrete, special circumstances /such as poor transportation facilities to remote areas, harsh climatic conditions, high seismic forces etc./ may render steel structures also competitive.

To the authors' knowledge, the first reticulated cooling tower has been built in Japan in the sixties, with a height of 45 m, having the shape of a double cone, erected with a truck-crane of the same height. The individual bars of the double-layer structure were tubes with diameters 76.3 and 114.3 mm, connected by bolts to hemispherical joints [1].

Greater dimensions and, above all, greater heights were made possible by changing the shape of the tower to a cylindrical one and applying the principle of the "sliding shuttering" of reinforced concrete silos to the steel tower /Fig. 1/.

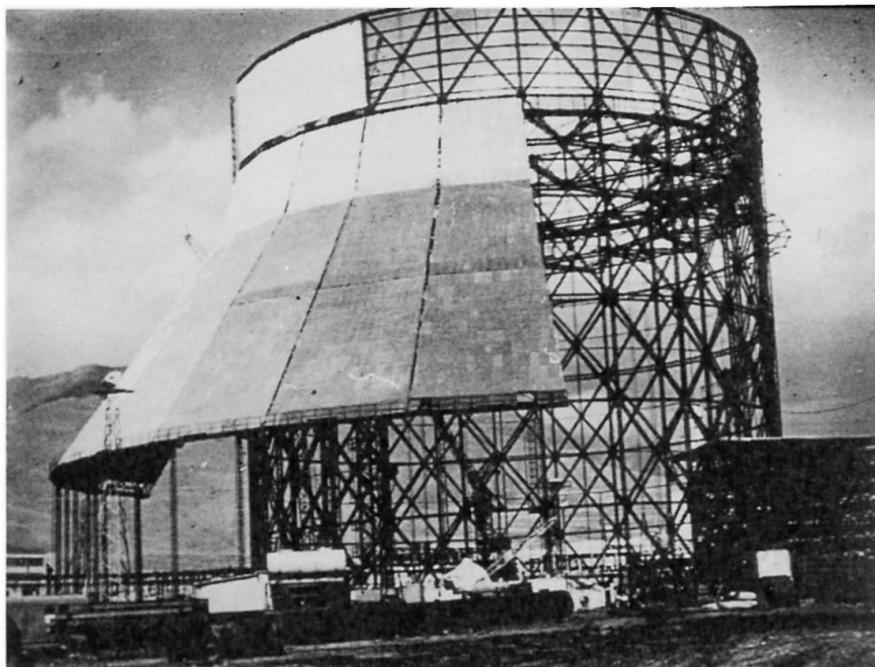


Fig. 1 Cooling tower during erection

Using the upper stiffening ring as a working platform, the panel elements of the structure could be lifted into place by assembly crane which moved around the ring. After one row of panels had been completed, the stiffening ring was lifted by hydraulic jacks, supported on the assembled panels, to the upper edge of the structure.

In order to save material, the individual bars were trusses themselves,

consisting of four angle sections as chords and four sets of bracing bars /Fig. 2/, constituting a double-layer space grid of wall thickness 610 mm.

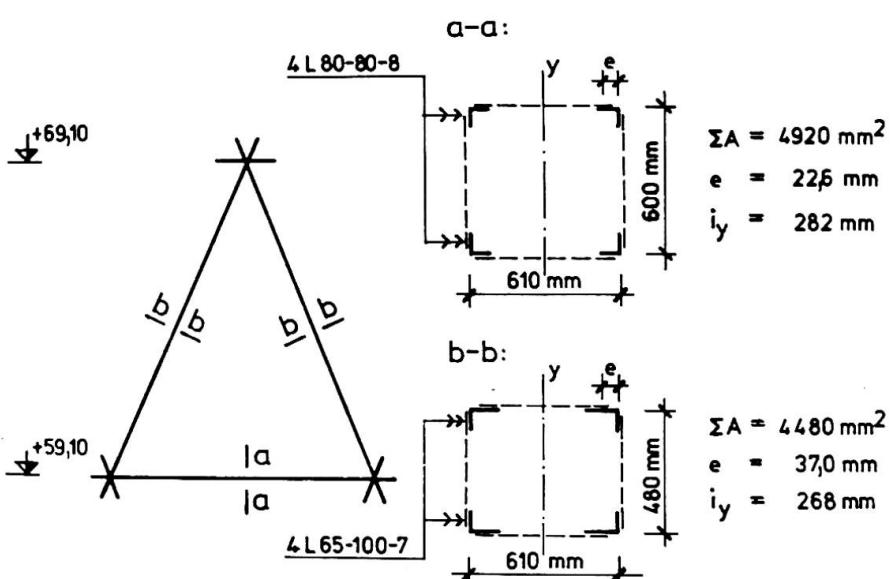


Fig. 2 Characteristic bar cross section

experience showed that the inconveniences of this solution, above all the use of a high crane for assembling the conical part, do not make up for the reduction of the weight.

Similarly, although the bar cross section shown Fig. 2 is very economical in material consumption, labour costs may render it more expensive than making the individual bars of one large section. The maximum height of towers that can be erected with the greatest angle sections available lies at about 160 m. All these considerations lead to a reticulated structure consisting of bars one tube each with a large diameter. We intend to proceed in this direction when designing large steel cooling towers in the future.

REFERENCES

1. SUZUKI E. & KITAMURA H., The design and construction of a cooling tower. In: Space Structures /DAVIES R. M. ed./ Blackwell Scientific Publications, Oxford and Edinburgh, 1967. pp. 656-664.
2. KOLLÁR L., Large reticulated steel cooling towers. Engng Struct., 1985. Vol. 7. pp. 263-267.

The individual bars were manufactured in the factory, they were connected on site to panels, of which the structure was built. All connections were welded. The towers built with this method had the heights of 120 and 150 m [2].

Further saving of material can be achieved if the lower part of the cylinder is replaced by a conical structure. However,