

**Zeitschrift:** IABSE structures = Constructions AIPC = IVBH Bauwerke  
**Band:** 3 (1979)  
**Heft:** C-7: Structures in Switzerland  
  
**Artikel:** Nuclear power plant, Goesgen-Daeniken / SO  
**Autor:** Gähler, Kurt  
**DOI:** <https://doi.org/10.5169/seals-15774>

### **Nutzungsbedingungen**

Die ETH-Bibliothek ist die Anbieterin der digitalisierten Zeitschriften auf E-Periodica. Sie besitzt keine Urheberrechte an den Zeitschriften und ist nicht verantwortlich für deren Inhalte. Die Rechte liegen in der Regel bei den Herausgebern beziehungsweise den externen Rechteinhabern. Das Veröffentlichen von Bildern in Print- und Online-Publikationen sowie auf Social Media-Kanälen oder Webseiten ist nur mit vorheriger Genehmigung der Rechteinhaber erlaubt. [Mehr erfahren](#)

### **Conditions d'utilisation**

L'ETH Library est le fournisseur des revues numérisées. Elle ne détient aucun droit d'auteur sur les revues et n'est pas responsable de leur contenu. En règle générale, les droits sont détenus par les éditeurs ou les détenteurs de droits externes. La reproduction d'images dans des publications imprimées ou en ligne ainsi que sur des canaux de médias sociaux ou des sites web n'est autorisée qu'avec l'accord préalable des détenteurs des droits. [En savoir plus](#)

### **Terms of use**

The ETH Library is the provider of the digitised journals. It does not own any copyrights to the journals and is not responsible for their content. The rights usually lie with the publishers or the external rights holders. Publishing images in print and online publications, as well as on social media channels or websites, is only permitted with the prior consent of the rights holders. [Find out more](#)

**Download PDF:** 14.12.2025

**ETH-Bibliothek Zürich, E-Periodica, <https://www.e-periodica.ch>**




## 10. Nuclear Power Plant, Goesgen—Daeniken / SO

Owner: Kernkraftwerk Goesgen-Daeniken AG  
 General Contractor: Kraftwerk Union AG  
 Engineers: Motor-Columbus Consulting Engineers Inc.  
 Construction years: 1973 – 1979

### Introduction

As it is well known, nuclear power plants all over the world have to fulfill very stringent safety requirements. In this respect, the buildings and the structural parts of the plant contribute an important part to the overall safety concept. They protect the plant against extreme external loads such as airplane crashes, severe earthquakes, and shock waves caused by external explosions. On the other hand they protect the environment and the population against any major consequences of internal incidents within the plant. Such improbable incidents may result in loads such as pressurization, temperature, pipe whip with corresponding restraint anchor forces and jet impingement forces. All such loads, which are to be borne by the buildings and structural parts of the plant are time dependent in most cases with complex time histories. This, combined with high reliability required for the design calculations and the construction, constitutes a new challenge to structural engineering.

In 1973 the utility company Kernkraftwerk Goesgen-Daeniken AG placed an order with Kraftwerk Union AG for the supply of a 900 MW pressurized water reactor system and at the same time Motor-Columbus Consulting Engineers Inc. have been commissioned with the structural design of the whole plant. The start of commercial operation is planned for Spring 1979.

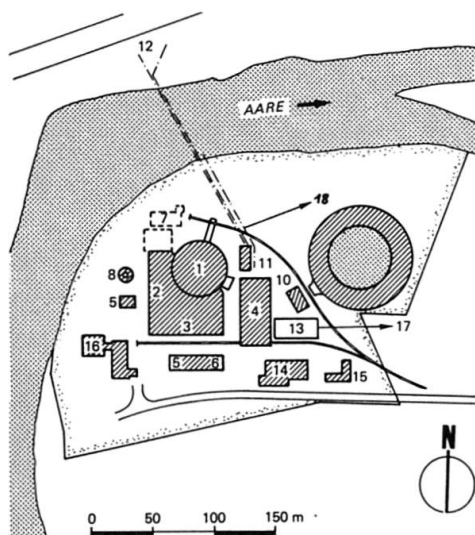

- |                                   |                                      |
|-----------------------------------|--------------------------------------|
| 1 REACTOR BUILDING                | 10 MAIN CIRCULATING WATER PUMP HOUSE |
| 2 REACTOR AUXILIARY BUILDING      | 11 SERVICE WATER PUMP HOUSE          |
| 3 ELECTRICAL BUILDING             | 12 SERVICE WATER INTAKE              |
| 4 TURBINE BUILDING                | 13 TRANSFORMER PLANT                 |
| 5 EMERGENCY POWER SUPPLY BUILDING | 14 WORKSHOP AND STORE BUILDING       |
| 6 MAKE-UP WATER BUILDING          | 15 GARAGES AND FIRE STATION          |
| 7 EMERGENCY FEEDWATER             | 16 ADMINISTRATION BUILDING           |
| 8 OFF-GAS STACK                   | 17 SWITCHYARD                        |
|                                   | 18 SERVICE WATER SYSTEM              |

Fig. 1

### General Layout of the Plant

In the center of the plant is located the cylindrical reactor building which is surrounded by the auxiliary building, the building for the emergency feedwater system, ventilation chimney, the electrical building and the turbine building, other buildings such as the cooling tower, pumping stations, canteen, administration building, workshop, etc. are grouped around the main block of the plant (see fig. 1). The most important building of the plant is the reactor building; it houses the whole reactor system (see fig. 2).

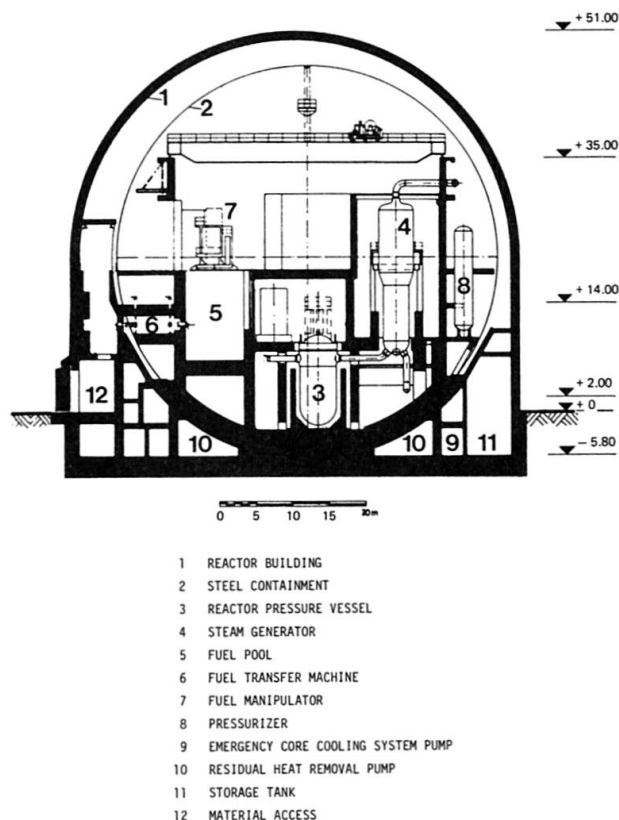


Fig. 2

### Foundation

All buildings are supported by mat foundations. Generally, the problems which occurred in the course of the structural design exceeded those of common industrial buildings for the following reasons:

- Large dimensions and weights of the structures (dead load of the reactor building 160'000 t)
- High reliability required for the settlement analysis (out of plumb deviation of the reactor building is not allowed)
- Structure to structure interaction
- Consideration of extreme load cases (earthquake, airplane crash, shock waves due to external explosions)



Fig. 3

Taking all this into consideration, a slab thickness of 2,75 m with 1'700 t reinforcing steel has to be provided for the reactor building. A special steel supporting structure was needed for the upper layer of reinforcement (see fig. 3).

#### Design of the Buildings

As all major loads are time dependent, many dynamic analyses had to be performed. To withstand such loads, a great amount of reinforcement is usually required (sometimes up to 1'000 kg/m<sup>3</sup>). In turn, this requires considerable skill on the part of the engineers to successfully design the arrangement of reinforcing steel.

#### Design Impact and Masses of Material

During the structural design of the plant, 60 to 70 engineers and draftsmen were involved. They have produced about 20'000 pages of handwritten design calculations, a two meter high pile of computer outputs and execution drawings. For the buildings and structures 180'000 cubic meters of concrete have been poured, 26'000 tons of reinforcing steel have been put in place and 360'000 square meters formwork have been erected.

(Kurt Gähler)

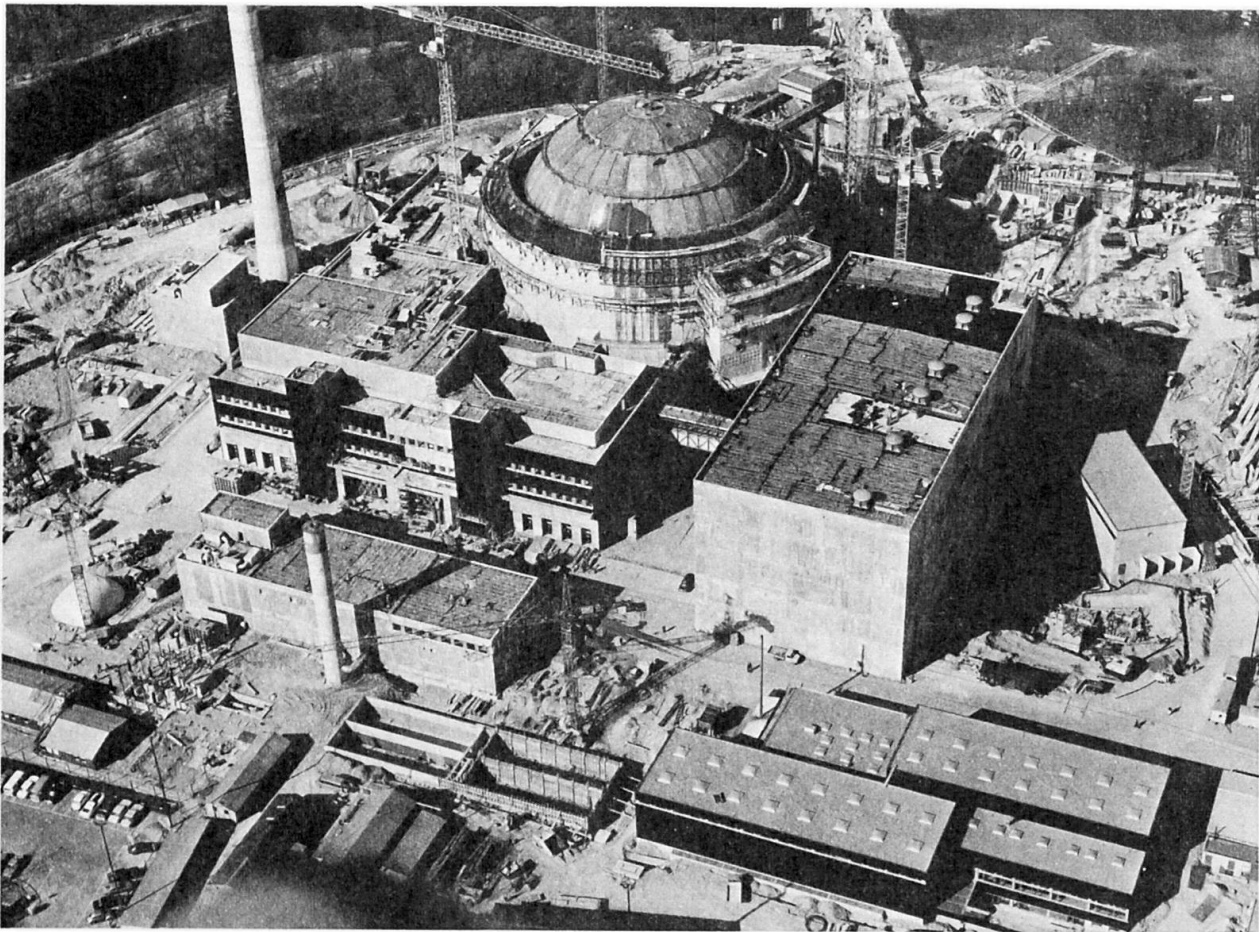


Fig. 4