

Zeitschrift: IABSE reports = Rapports AIPC = IVBH Berichte

Band: 70 (1993)

Artikel: Seismic evaluation of a brick masonry building of 1895

Autor: Kanada, Kazuhiro / Udagawa, Kimio / Shimizu, Toyakazu

DOI: <https://doi.org/10.5169/seals-53366>

Nutzungsbedingungen

Die ETH-Bibliothek ist die Anbieterin der digitalisierten Zeitschriften auf E-Periodica. Sie besitzt keine Urheberrechte an den Zeitschriften und ist nicht verantwortlich für deren Inhalte. Die Rechte liegen in der Regel bei den Herausgebern beziehungsweise den externen Rechteinhabern. Das Veröffentlichen von Bildern in Print- und Online-Publikationen sowie auf Social Media-Kanälen oder Webseiten ist nur mit vorheriger Genehmigung der Rechteinhaber erlaubt. [Mehr erfahren](#)

Conditions d'utilisation

L'ETH Library est le fournisseur des revues numérisées. Elle ne détient aucun droit d'auteur sur les revues et n'est pas responsable de leur contenu. En règle générale, les droits sont détenus par les éditeurs ou les détenteurs de droits externes. La reproduction d'images dans des publications imprimées ou en ligne ainsi que sur des canaux de médias sociaux ou des sites web n'est autorisée qu'avec l'accord préalable des détenteurs des droits. [En savoir plus](#)

Terms of use

The ETH Library is the provider of the digitised journals. It does not own any copyrights to the journals and is not responsible for their content. The rights usually lie with the publishers or the external rights holders. Publishing images in print and online publications, as well as on social media channels or websites, is only permitted with the prior consent of the rights holders. [Find out more](#)

Download PDF: 01.04.2026

ETH-Bibliothek Zürich, E-Periodica, <https://www.e-periodica.ch>

Seismic Evaluation of a Brick Masonry Building of 1895

Comportement aux séismes d'un bâtiment en maçonnerie de 1895

Erbebenverhalten eines Backsteingebäudes von 1895

Kazuhiro KANADA

Taisei Corporation
Japan

Toyakazu SHIMIZU

Ministry of Construction
Japan

Kimio UDAGAWA

Taisei Corporation
Japan

Akiyoshi SATO

Ministry of Construction
Japan

1. Introduction

This paper describes the seismic appraisal of existing masonry building and the measures needed to ensure the structural meets modern Tokyo seismic requirements. Fig. 1 shows the first plan.

2. Response Analysis of the building

As the structural characteristic in the plan, X and Y directions are different, separate models were created for each direction (see Fig. 2). Each floor was assumed to consists of 5 lumped masses, connected by assumed stiffness for floor slab derived from the test-recorded stiffness value for the wall (see Part 1). Thus vertically, the masses are connected by the brick wall stiffness value based on the shear modulus, and horizontally the masses connected by the floor slab stiffness having both shear and axial components.

The calculation models are shown Fig. 3.

By Comparing the buildings dynamic characteristics, the input seismic waves adopted for analysis were EL CENTRO (1940 NS), HACHINOHE (1968 NS), TAFT (1952 EW) and TOKYO (1956 NS).

The fundamental natural frequency of the structure was calculated as 5 Hz (approx.) and the peak value of input acceleration normalized to 200 cm/s^2 . The base of the structure's foundation was assumed as fixed against rotation in consideration of the restraint provided by the soil and the soil's damping factor ratio assumed as 7%.

From the analysis, the maximum response analysis in the X direction was 561 cm/s^2 (TAFT), representing an amplification factor of 2.81, and in the Y direction was 610 cm/s^2 (HACHINOHE), an amplification of 3.05. (Table 1)

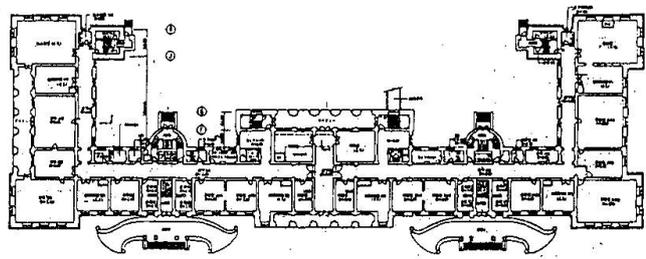


Fig 1 Building Plan (1st Floor)




Fig 2 Building Sub-division for Modeling

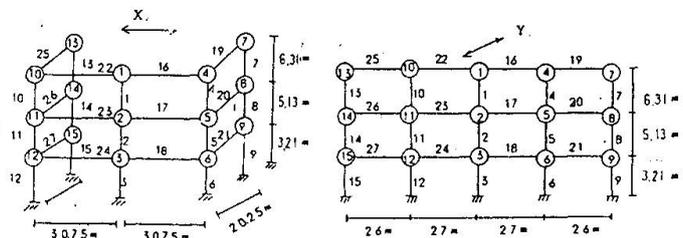


Fig 3 Building Model for Calculation



Table 1 Maximum Response of Mass Points

Block	No.	X - direction TAFT 1952 EW 200cm/s ²					Y - direction HACHINOHE 1968 NS 200cm/s ²				
		DISP. (TIME)	VEL. (TIME)	ACC. (TIME)	DISP. (TIME)	VEL. (TIME)	ACC. (TIME)	DISP. (TIME)	VEL. (TIME)	ACC. (TIME)	
C	1	0.33 (4.69)	11.1 (4.64)	406. (4.60)	0.64 (4.16)	14.2 (4.10)	580. (4.15)				
	2	0.20 (4.69)	6.6 (4.64)	272. (4.69)	0.46 (4.16)	10.3 (4.10)	462. (4.16)				
	3	0.08 (4.69)	2.5 (4.64)	202. (3.71)	0.15 (4.16)	3.1 (4.10)	278. (4.16)				
B	4	0.37 (4.69)	12.4 (4.65)	451. (4.69)	0.67 (4.16)	14.9 (4.10)	610. (4.15)				
	5	0.25 (4.69)	8.0 (4.65)	319. (4.69)	0.43 (4.16)	9.6 (4.10)	438. (4.15)				
	6	0.09 (4.69)	2.9 (4.65)	205. (6.55)	0.18 (4.16)	4.0 (4.10)	295. (4.16)				
A	7	0.47 (4.70)	15.7 (4.65)	561. (4.69)	0.50 (4.16)	11.1 (4.10)	490. (4.15)				
	8	0.31 (4.70)	10.1 (4.65)	386. (4.69)	0.34 (4.16)	7.5 (4.10)	389. (4.15)				
	9	0.10 (4.70)	3.3 (4.65)	214. (6.56)	0.13 (4.16)	2.7 (4.10)	285. (4.15)				
B'	10	0.40 (4.69)	13.4 (4.65)	484. (4.69)	0.63 (4.16)	14.1 (4.10)	587. (4.15)				
	11	0.28 (4.69)	8.6 (4.65)	339. (4.69)	0.40 (4.16)	8.9 (4.10)	417. (4.15)				
	12	0.10 (4.69)	3.1 (4.65)	210. (6.55)	0.17 (4.16)	3.7 (4.10)	286. (4.16)				
A'	13	0.47 (4.70)	15.7 (4.65)	558. (4.69)	0.47 (4.16)	10.4 (4.10)	472. (4.15)				
	14	0.31 (4.70)	10.1 (4.65)	387. (4.69)	0.29 (4.16)	6.4 (4.10)	355. (4.15)				
	15	0.11 (4.69)	3.3 (4.65)	216. (6.55)	0.11 (4.16)	2.3 (4.09)	253. (4.15)				

Table 2 Allowable Stress (MPa)

	Testing Value	Short Term	
Compression	6.0	4.0	
Bending	0.15	0.10	
Tension	0.15	0.10	
Shear	3rd fl.	0.30	0.20
	2nd fl.	0.35	0.23
	1st fl.	0.40	0.27

3. Structural Assessment from Results of Response Analysis

Masonry allowable stresses are obtained directly from testing and divided by a safety factor of 1.5 for short term (seismic) conditions. (Table 2)

Maximum responses shear forces and average shear stresses, based on the 200cm/s² input acceleration, are shown in Table 3.

Areas exceeding the allowable stress are also indicated (mark *).

The stresses from the maximum response forces in the slab are in all cases less than allowable stresses.

From the results discussed, it was decided to reinforce those walls which were shown to be over stressed, by constructing reinforced concrete strengthening walls connected by shear stud bolts to the existing walls. The maximum shear stress in the upgraded wall, which in all cases are less than the allowable stresses.

Regarding out-of-plane direction (perpendicular to masonry walls), shear forces based on the maximum response acceleration of inplane direction are adopted as the external forces to check the wall bending bearing capacity (Fig.4). By means of this calculation, at thin walls such as 380mm THK., 510mm THK. steel plates (3.2mm THK.) are installed at both sides of the wall surface to strengthen flexural capacity.

Table 3 Maximum Shear Stresses in Wall

X-Dir	FL	Mem. No.	Weight (KN)	Shear Area (m ²)	Sh. Force (KN)	Shear Stress (MPa)
A	3	7	8480	20.7	4150	0.20
	2	8	9650	24.1	7520	0.31
	1	9	8750	35.4	9500	0.27
A'	3	13	8780	22.5	4390	0.20
	2	14	10570	26.0	8040	0.31
	1	15	9720	37.6	10300	0.27
B	3	4	11360	34.6	5650	0.16
	2	5	13820	41.3	10010	0.24
	1	6	11830	51.9	12990	0.25
B'	3	10	11430	31.9	5610	0.18
	2	11	14010	39.7	10040	0.25
	1	12	13060	49.7	13290	0.27
C	3	1	26410	75.8	13240	0.17
	2	2	33150	115.9	23730	0.20
	1	3	29230	140.1	31330	0.22

Y-Dir	FL	Mem. No.	Weight (KN)	Shear Area (m ²)	Sh. Force (KN)	Shear Stress (MPa)
A	3	7	14660	49.6	8700	0.18
	2	8	16750	54.1	16070	0.30
	1	9	14990	73.3	20630	0.28
A'	3	13	15020	43.2	8510	0.20
	2	14	18490	64.5	16180	0.25
	1	15	17200	87.9	21180	0.24
B	3	4	10350	17.6	4740	0.27
	2	5	13440	29.7	10190	0.34
	1	6	11180	31.6	12790	0.40
B'	3	10	10370	18.2	4790	0.26
	2	11	12180	29.7	9370	0.32
	1	12	11160	31.6	11890	0.38
C	3	1	16050	49.3	9700	0.20
	2	2	20340	43.0	18680	0.43
	1	3	18060	74.6	24220	0.32

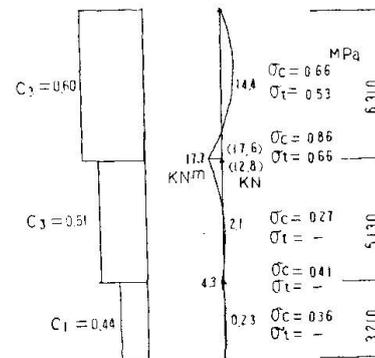


Fig 4 Bending Diagram Perpendicular to Wall

4. Conclusion

From the response analysis, it was shown the the natural period of the structure is 0.2 seconds as compared to 0.33 seconds for the surrounding soil. This large difference would appear to partly explain why the building didn't suffer any severe damage when struck by the Kanto earthquake.

Thus, structural stability is maintained for an input level up to 200 cm/s² at the ground surface. Further, if the ultimate strength is assumed to be equivalent to the material strength obtained from testing and some of the walls are upgraded as described above, the structure should withstand ground surface accelerations up to 300-400cm/s².

Despite the building's 100 years of age, it can be seen that this famous old building can remain in their masonry building for many years to come. This study also illustrates how masonry (or indeed other materials) can be engineered to create seismic resistant structures.